



文件创建于：2024/06/14 08:26:59

数据报告

监测点信息

监测点名称：GCP冷藏箱
监测点位置：何贤纪念医院<何贤院区>GCP药房

标签1信息


标签ID：ZHT12104A305 标签名称：冷藏(4A305)
数据开始时间：2024-06-14 00:02:00 数据结束时间：2024-06-14 08:27:00

温度统计信息

上限：7.8000 °C 最大值：6.00 °C
下限：2.2000 °C 最小值：5.57 °C
平均值：5.78 °C

湿度统计信息

上限：75.0000%RH 最大值：82.04%RH
下限：35.0000%RH 最小值：53.03%RH
平均值：67.94%RH

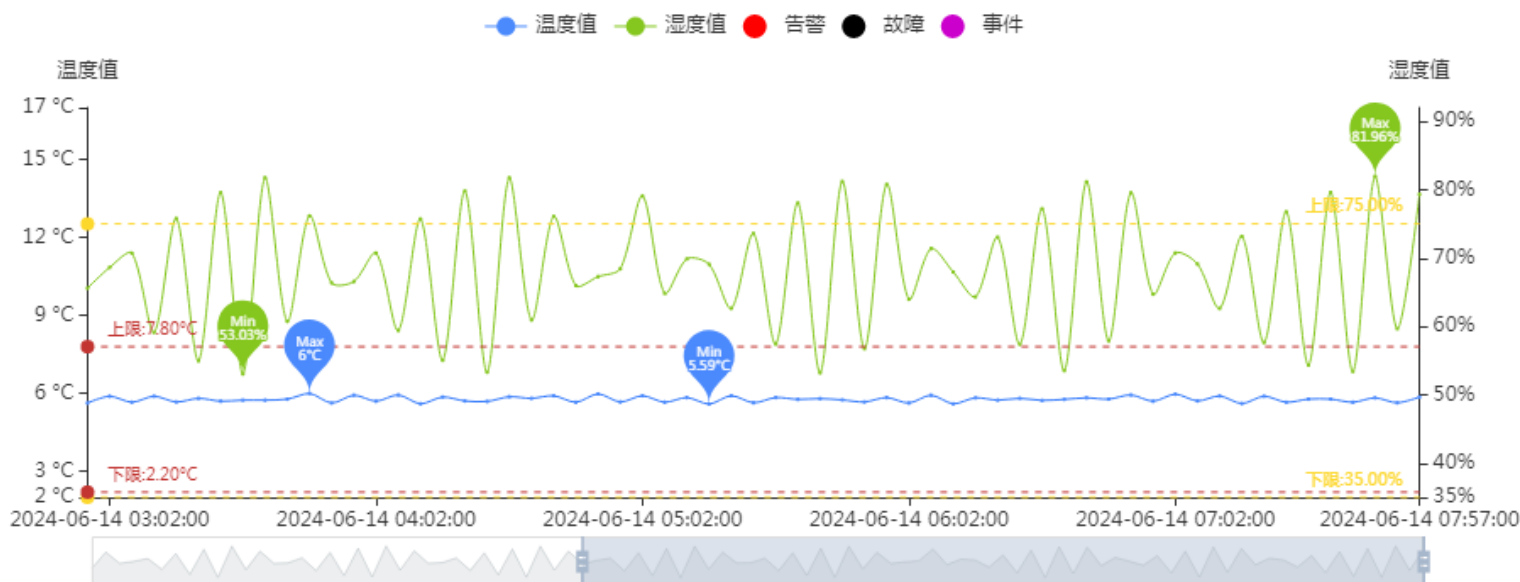

全部数据

记录时间	温度(°C)	湿度(%RH)
2024-06-14 00:02:00	5.67	61.30
2024-06-14 00:07:00	5.89	76.33
2024-06-14 00:12:00	5.67	66.06
2024-06-14 00:17:00	5.90	67.83
2024-06-14 00:22:00	5.70	70.46
2024-06-14 00:27:00	5.98	60.63
2024-06-14 00:32:00	5.77	74.97
2024-06-14 00:37:00	5.78	56.02
2024-06-14 00:42:00	5.80	78.88
2024-06-14 00:47:00	5.78	53.29
2024-06-14 00:52:00	5.89	81.85
2024-06-14 00:57:00	5.60	60.38
2024-06-14 01:02:00	5.91	77.14
2024-06-14 01:07:00	5.57	66.06
2024-06-14 01:12:00	5.83	66.45
2024-06-14 01:17:00	5.63	71.14
2024-06-14 01:22:00	5.89	59.45
2024-06-14 01:27:00	5.74	75.90
2024-06-14 01:32:00	5.77	54.93
2024-06-14 01:37:00	5.77	79.84
2024-06-14 01:42:00	5.77	53.68
2024-06-14 01:47:00	5.90	82.04
2024-06-14 01:52:00	5.71	59.86
2024-06-14 01:57:00	5.89	77.53
2024-06-14 02:02:00	5.70	66.15
2024-06-14 02:07:00	5.87	66.68
2024-06-14 02:12:00	5.64	70.99
2024-06-14 02:17:00	5.98	59.63
2024-06-14 02:22:00	5.80	75.59
2024-06-14 02:27:00	5.83	55.59
2024-06-14 02:32:00	5.78	79.20
2024-06-14 02:37:00	5.87	53.47
2024-06-14 02:42:00	5.87	81.80
2024-06-14 02:47:00	5.66	59.93
2024-06-14 02:52:00	5.97	77.16
2024-06-14 02:57:00	5.63	65.59
2024-06-14 03:02:00	5.89	68.63
2024-06-14 03:07:00	5.66	70.71
2024-06-14 03:12:00	5.89	59.13
2024-06-14 03:17:00	5.67	75.79
2024-06-14 03:22:00	5.81	54.95
2024-06-14 03:27:00	5.70	79.58
2024-06-14 03:32:00	5.74	53.03
2024-06-14 03:37:00	5.74	81.77
2024-06-14 03:42:00	5.78	60.74
2024-06-14 03:47:00	6.00	76.17
2024-06-14 03:52:00	5.63	66.36
2024-06-14 03:57:00	5.93	66.56
2024-06-14 04:02:00	5.70	70.73
2024-06-14 04:07:00	5.94	59.41
2024-06-14 04:12:00	5.60	75.71

2024-06-14 04:17:00	5.86	55.04
2024-06-14 04:22:00	5.71	79.81
2024-06-14 04:27:00	5.69	53.29
2024-06-14 04:32:00	5.87	81.76
2024-06-14 04:37:00	5.81	60.94
2024-06-14 04:42:00	5.91	76.08
2024-06-14 04:47:00	5.66	65.97
2024-06-14 04:52:00	5.98	67.28
2024-06-14 04:57:00	5.67	68.43
2024-06-14 05:02:00	5.91	79.07
2024-06-14 05:07:00	5.66	64.84
2024-06-14 05:12:00	5.84	69.87
2024-06-14 05:17:00	5.59	69.09
2024-06-14 05:22:00	5.91	62.64
2024-06-14 05:27:00	5.64	73.59
2024-06-14 05:32:00	5.84	57.43
2024-06-14 05:37:00	5.77	78.06
2024-06-14 05:42:00	5.80	53.21
2024-06-14 05:47:00	5.75	81.20
2024-06-14 05:52:00	5.67	56.75
2024-06-14 05:57:00	5.84	80.78
2024-06-14 06:02:00	5.63	63.98
2024-06-14 06:07:00	5.93	71.38
2024-06-14 06:12:00	5.60	67.95
2024-06-14 06:17:00	5.83	64.33
2024-06-14 06:22:00	5.74	73.05
2024-06-14 06:27:00	5.81	57.38
2024-06-14 06:32:00	5.73	77.21
2024-06-14 06:37:00	5.77	53.53
2024-06-14 06:42:00	5.83	81.15
2024-06-14 06:47:00	5.78	57.89
2024-06-14 06:52:00	5.94	79.54
2024-06-14 06:57:00	5.70	64.71
2024-06-14 07:02:00	5.97	70.74
2024-06-14 07:07:00	5.71	69.13
2024-06-14 07:12:00	5.90	62.64
2024-06-14 07:17:00	5.61	73.16
2024-06-14 07:22:00	5.89	57.65
2024-06-14 07:27:00	5.66	76.77
2024-06-14 07:32:00	5.78	54.33
2024-06-14 07:37:00	5.78	79.59
2024-06-14 07:42:00	5.66	53.40
2024-06-14 07:47:00	5.83	81.96
2024-06-14 07:52:00	5.64	59.66
2024-06-14 07:57:00	5.86	79.32
2024-06-14 08:02:00	5.70	64.80
2024-06-14 08:07:00	5.91	71.65
2024-06-14 08:12:00	5.60	68.58
2024-06-14 08:17:00	5.84	64.52
2024-06-14 08:22:00	5.61	71.60
2024-06-14 08:27:00	5.86	59.86